
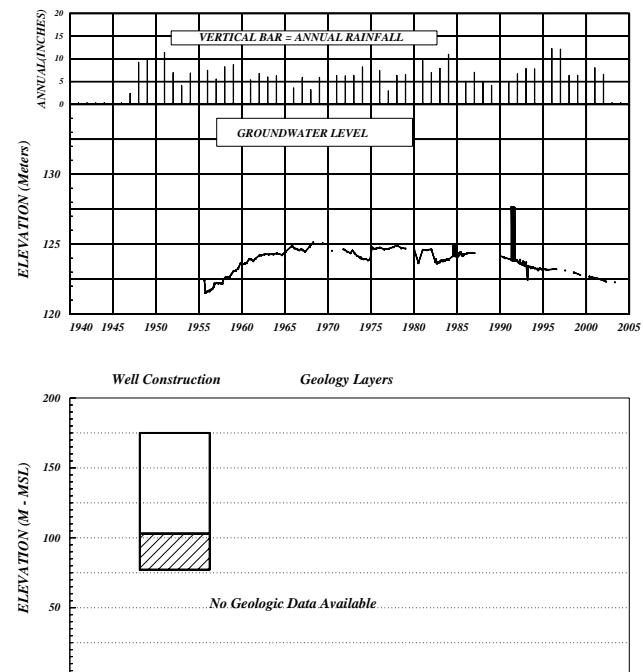
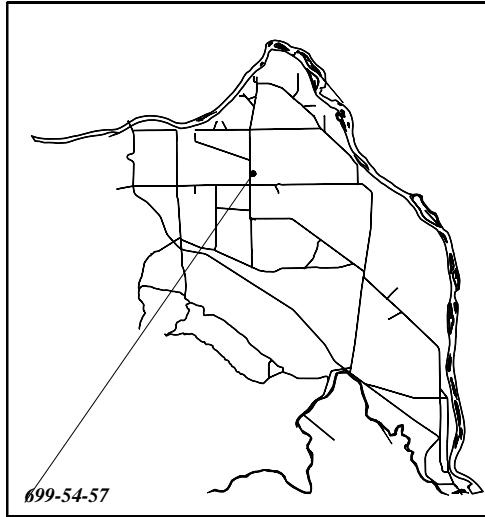


# DOE HANFORD SITE - GROUNDWATER QUALITY DATA PLOTS

wellseries-600-699 WELL#=699-54-57

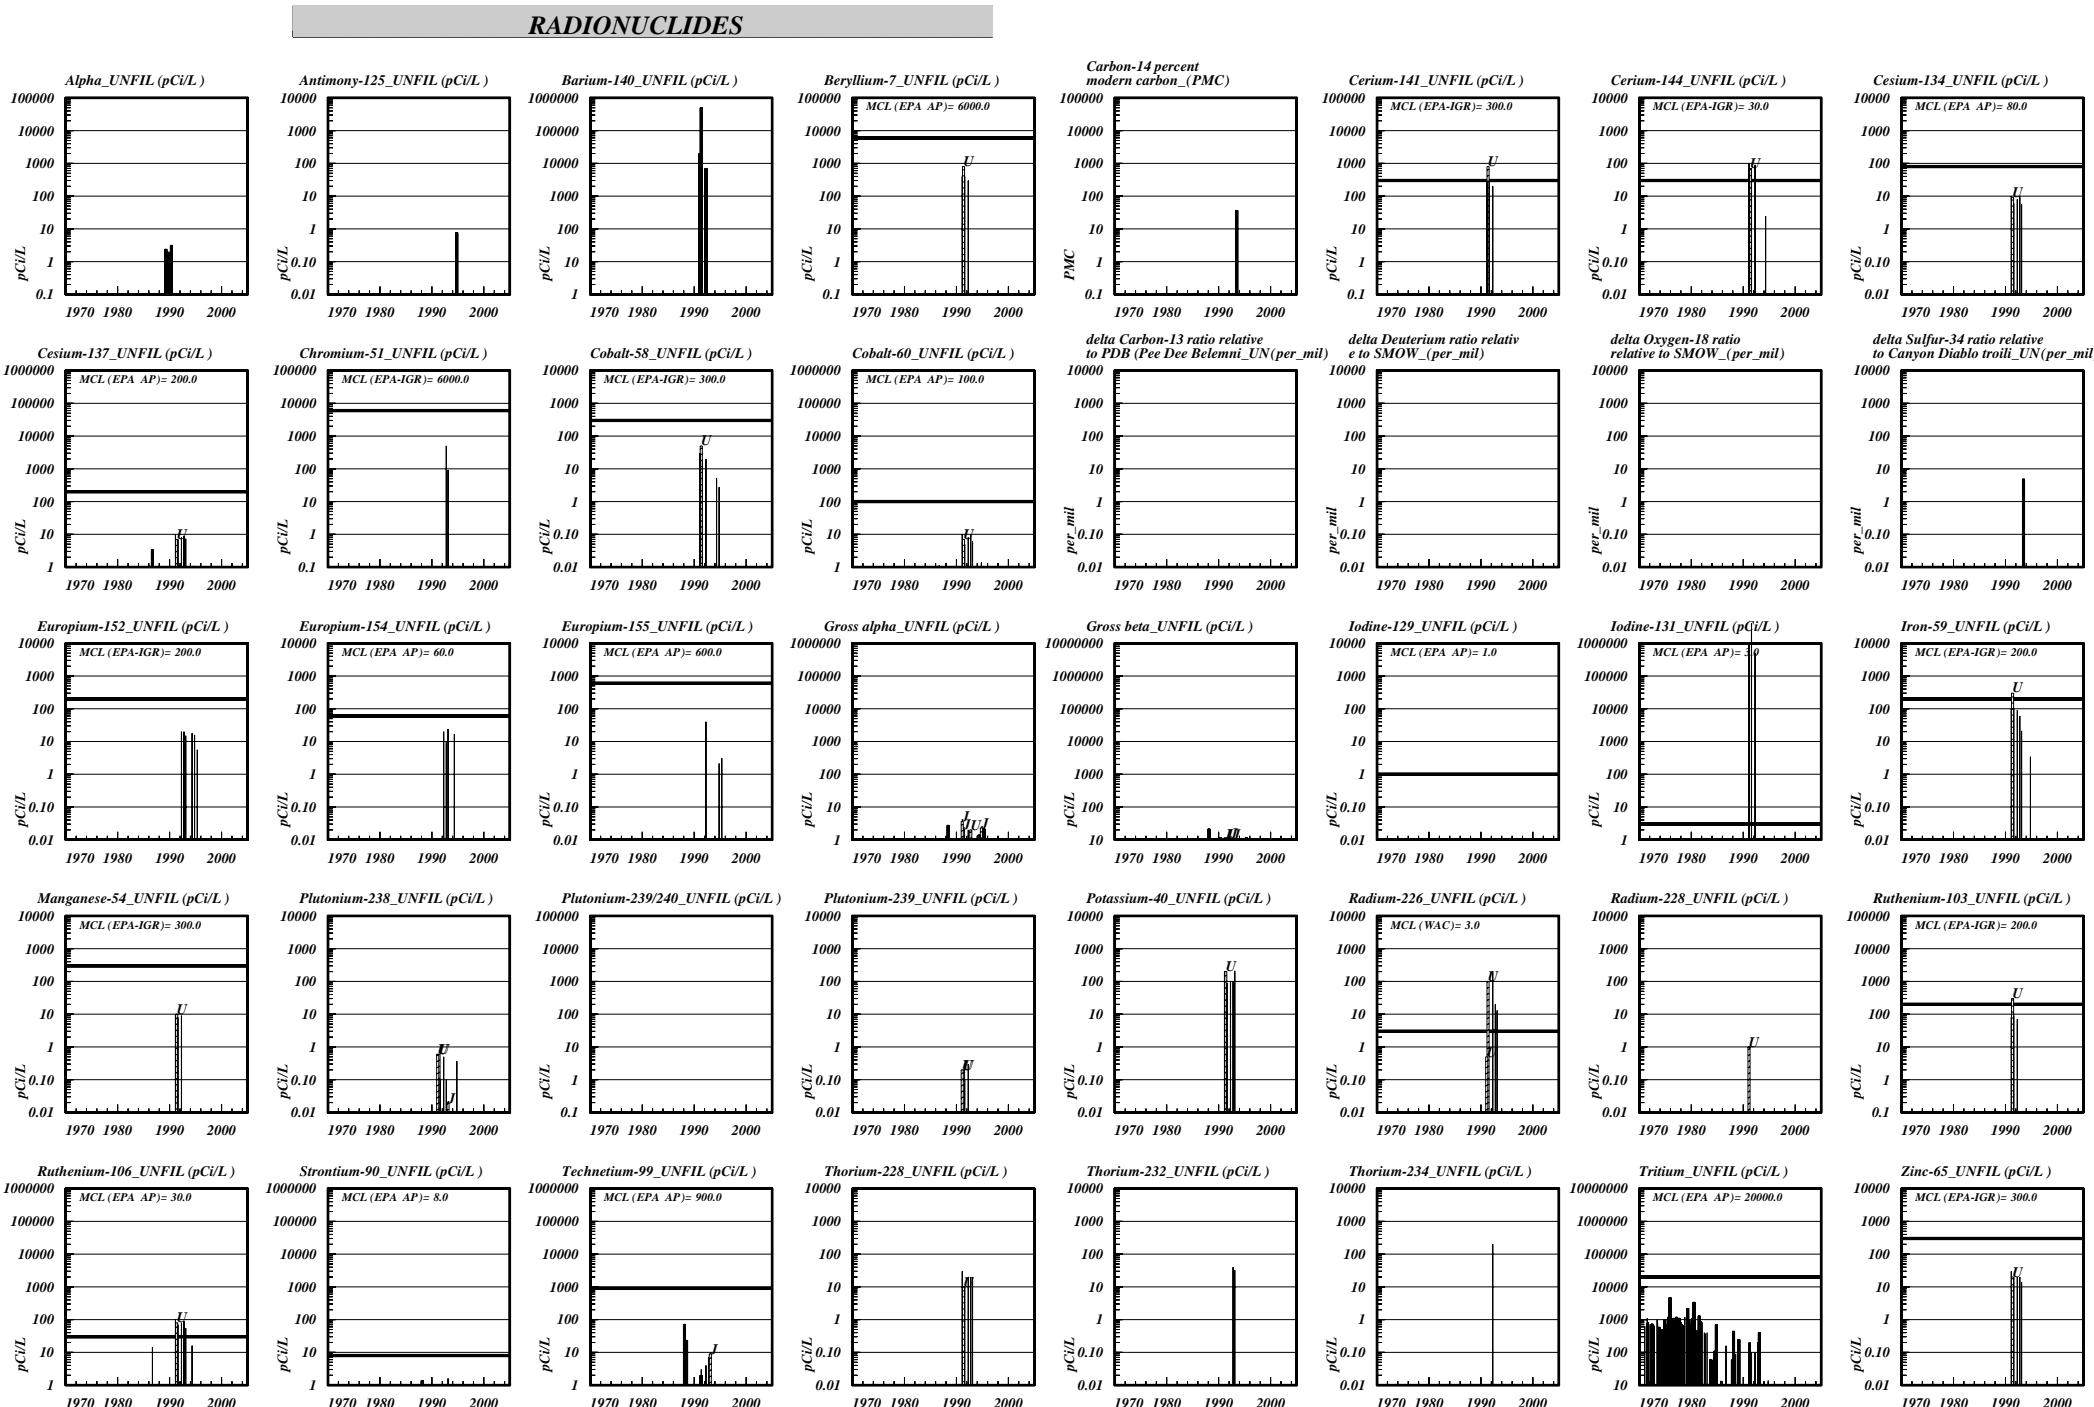

WELLNAME=699-54-57 WELLID=A5253	
Well Type=STANDARD	Well purpose=GROUNDWATER
Owner=DOE	Contact=BHI Well Admin Compliance=NON-COMPLIANT
X_coor=572619.50	Y_coor=140029.60 Datum=NAD83(91) Date Survey=1/15/1993
Elevation= 175.04	Datum=NGVD29 Date Survey=12/05/92
Ref Point Desc=BRASS CAP	Ref Point side=NONE Contractor=USACE(JECA)
Total Number of Screen Intervals=1	
Screen#=1	Screen diam= 5.00 in Top= 71.93 Bottom= 97.84 m Slot_size= 0.00
Screen_material=Stainless Steel	
Total Number of Seals=3	
Seal#1 Depth_top=-0.15	Bottom= 6.10 m Material=Cement Grout
Seal#2 Depth_top= 48.46	Bottom= 60.66 m Material=Cement Grout
Seal#3 Depth_top= 68.58	Bottom= 74.68 m Material=Cement Grout
More Information is at <a href="http://www.envirodataaccess.com/wellfiles/699-54-57.htm">http://www.envirodataaccess.com/wellfiles/699-54-57.htm</a>	


LABORATORY QUALIFIER FLAGS in HEIS are \*, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound:  
EPA-IGR=EPA-Implementation Guidance for Radionuclides: WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag


# DOE HANFORD SITE - GROUNDWATER QUALITY DATA PLOTS

wellseries-600-699 WELL#=699-54-57

## RADIOMUCLIDES




## VOLATILE ORGANIC COMPOUNDS

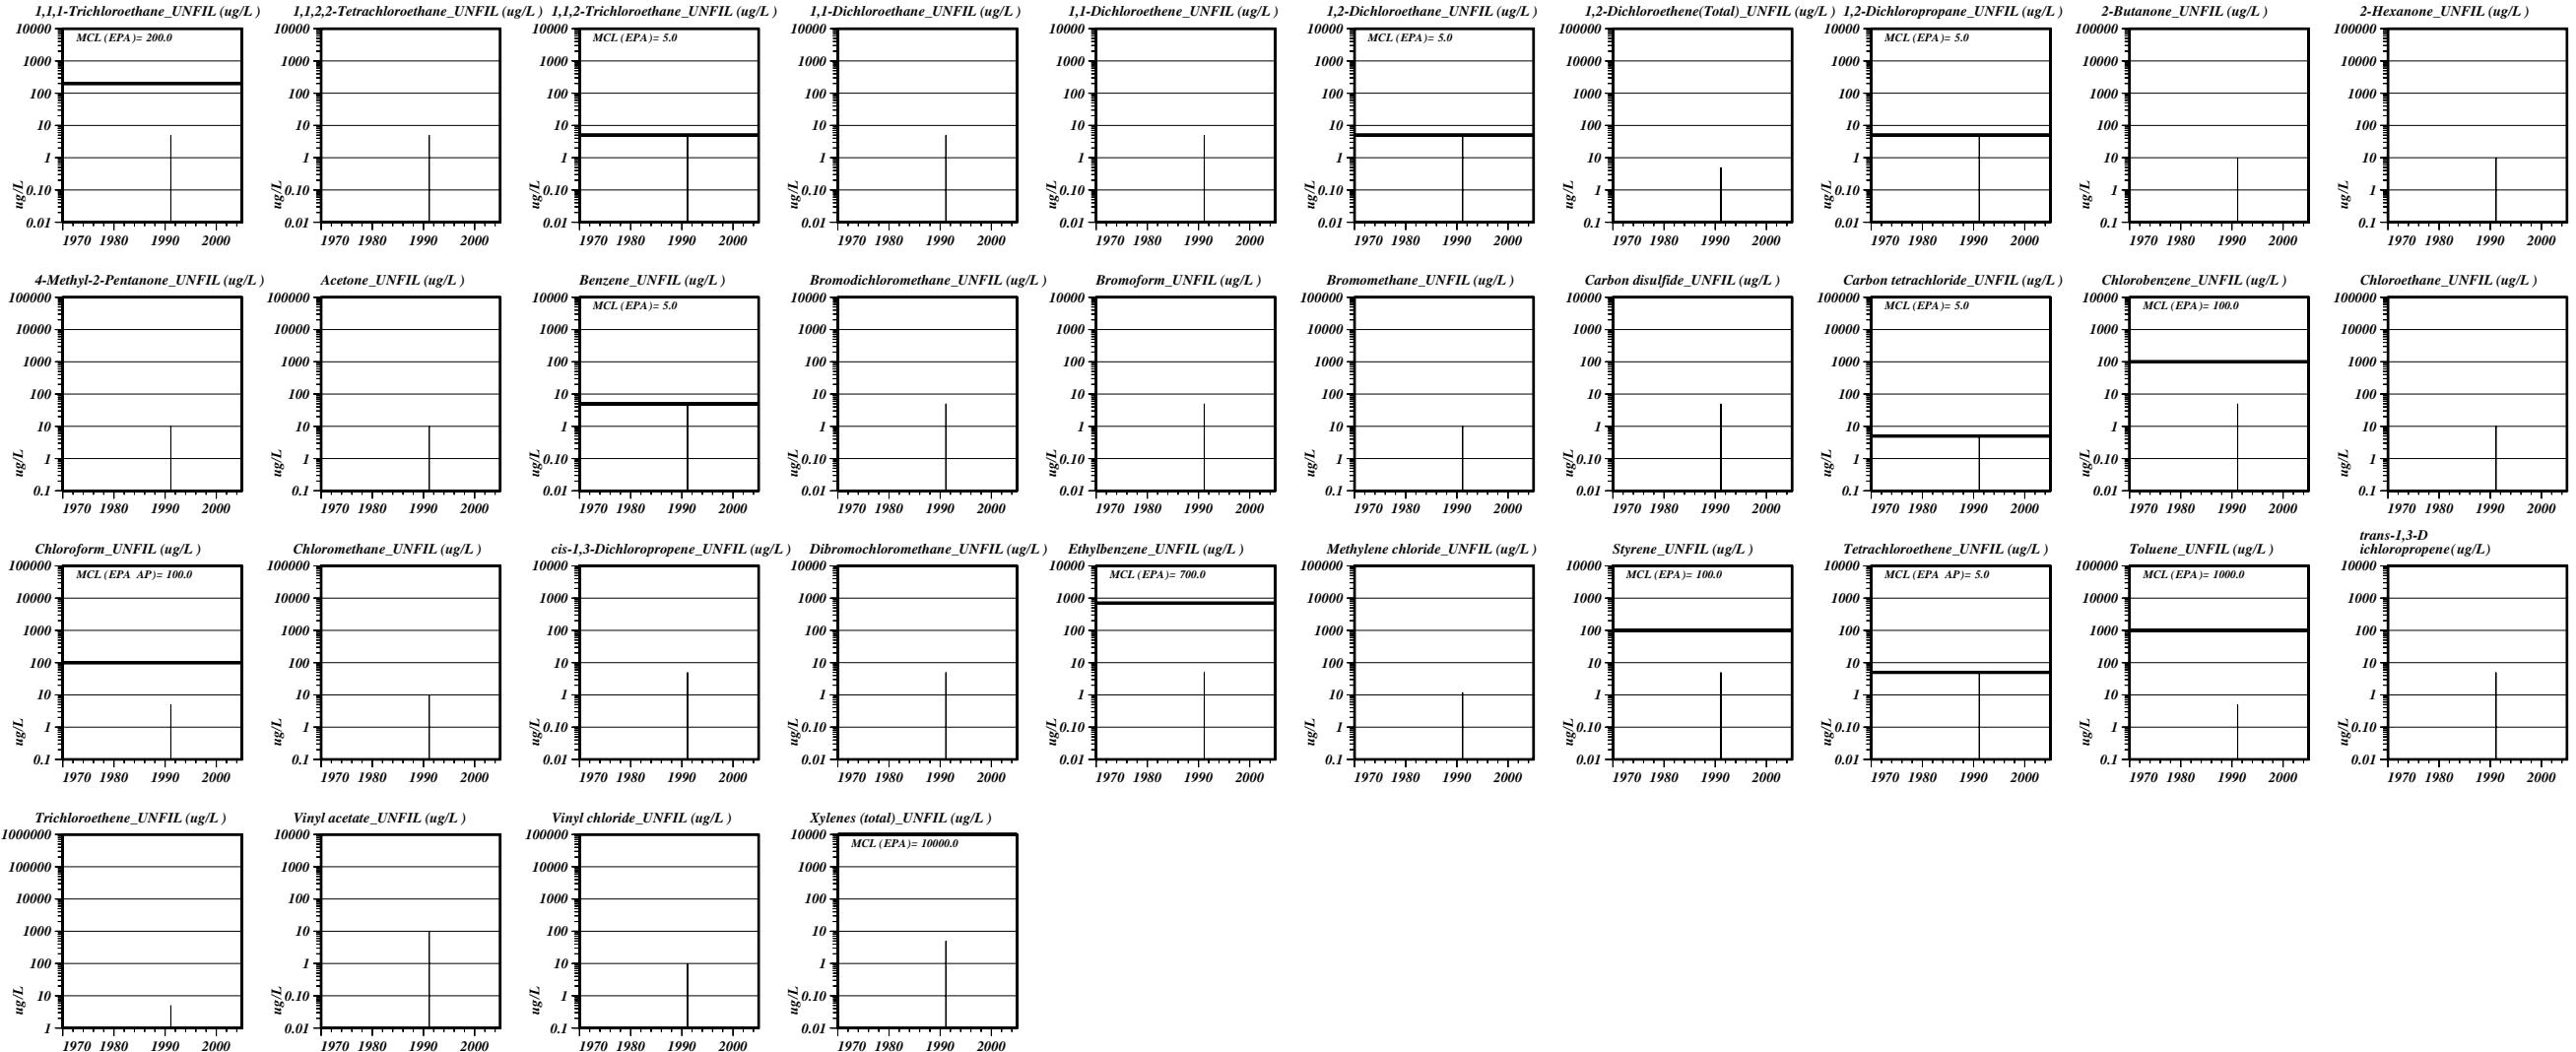

LABORATORY QUALIFIER FLAGS in HEIS are \*, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound;  
EPA-IGR=EPA-Implementation Guidance for Radionuclides; WAC=Washington Administrative Code:



EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag

## SEMI-VOLATILE ORGANIC COMPOUNDS

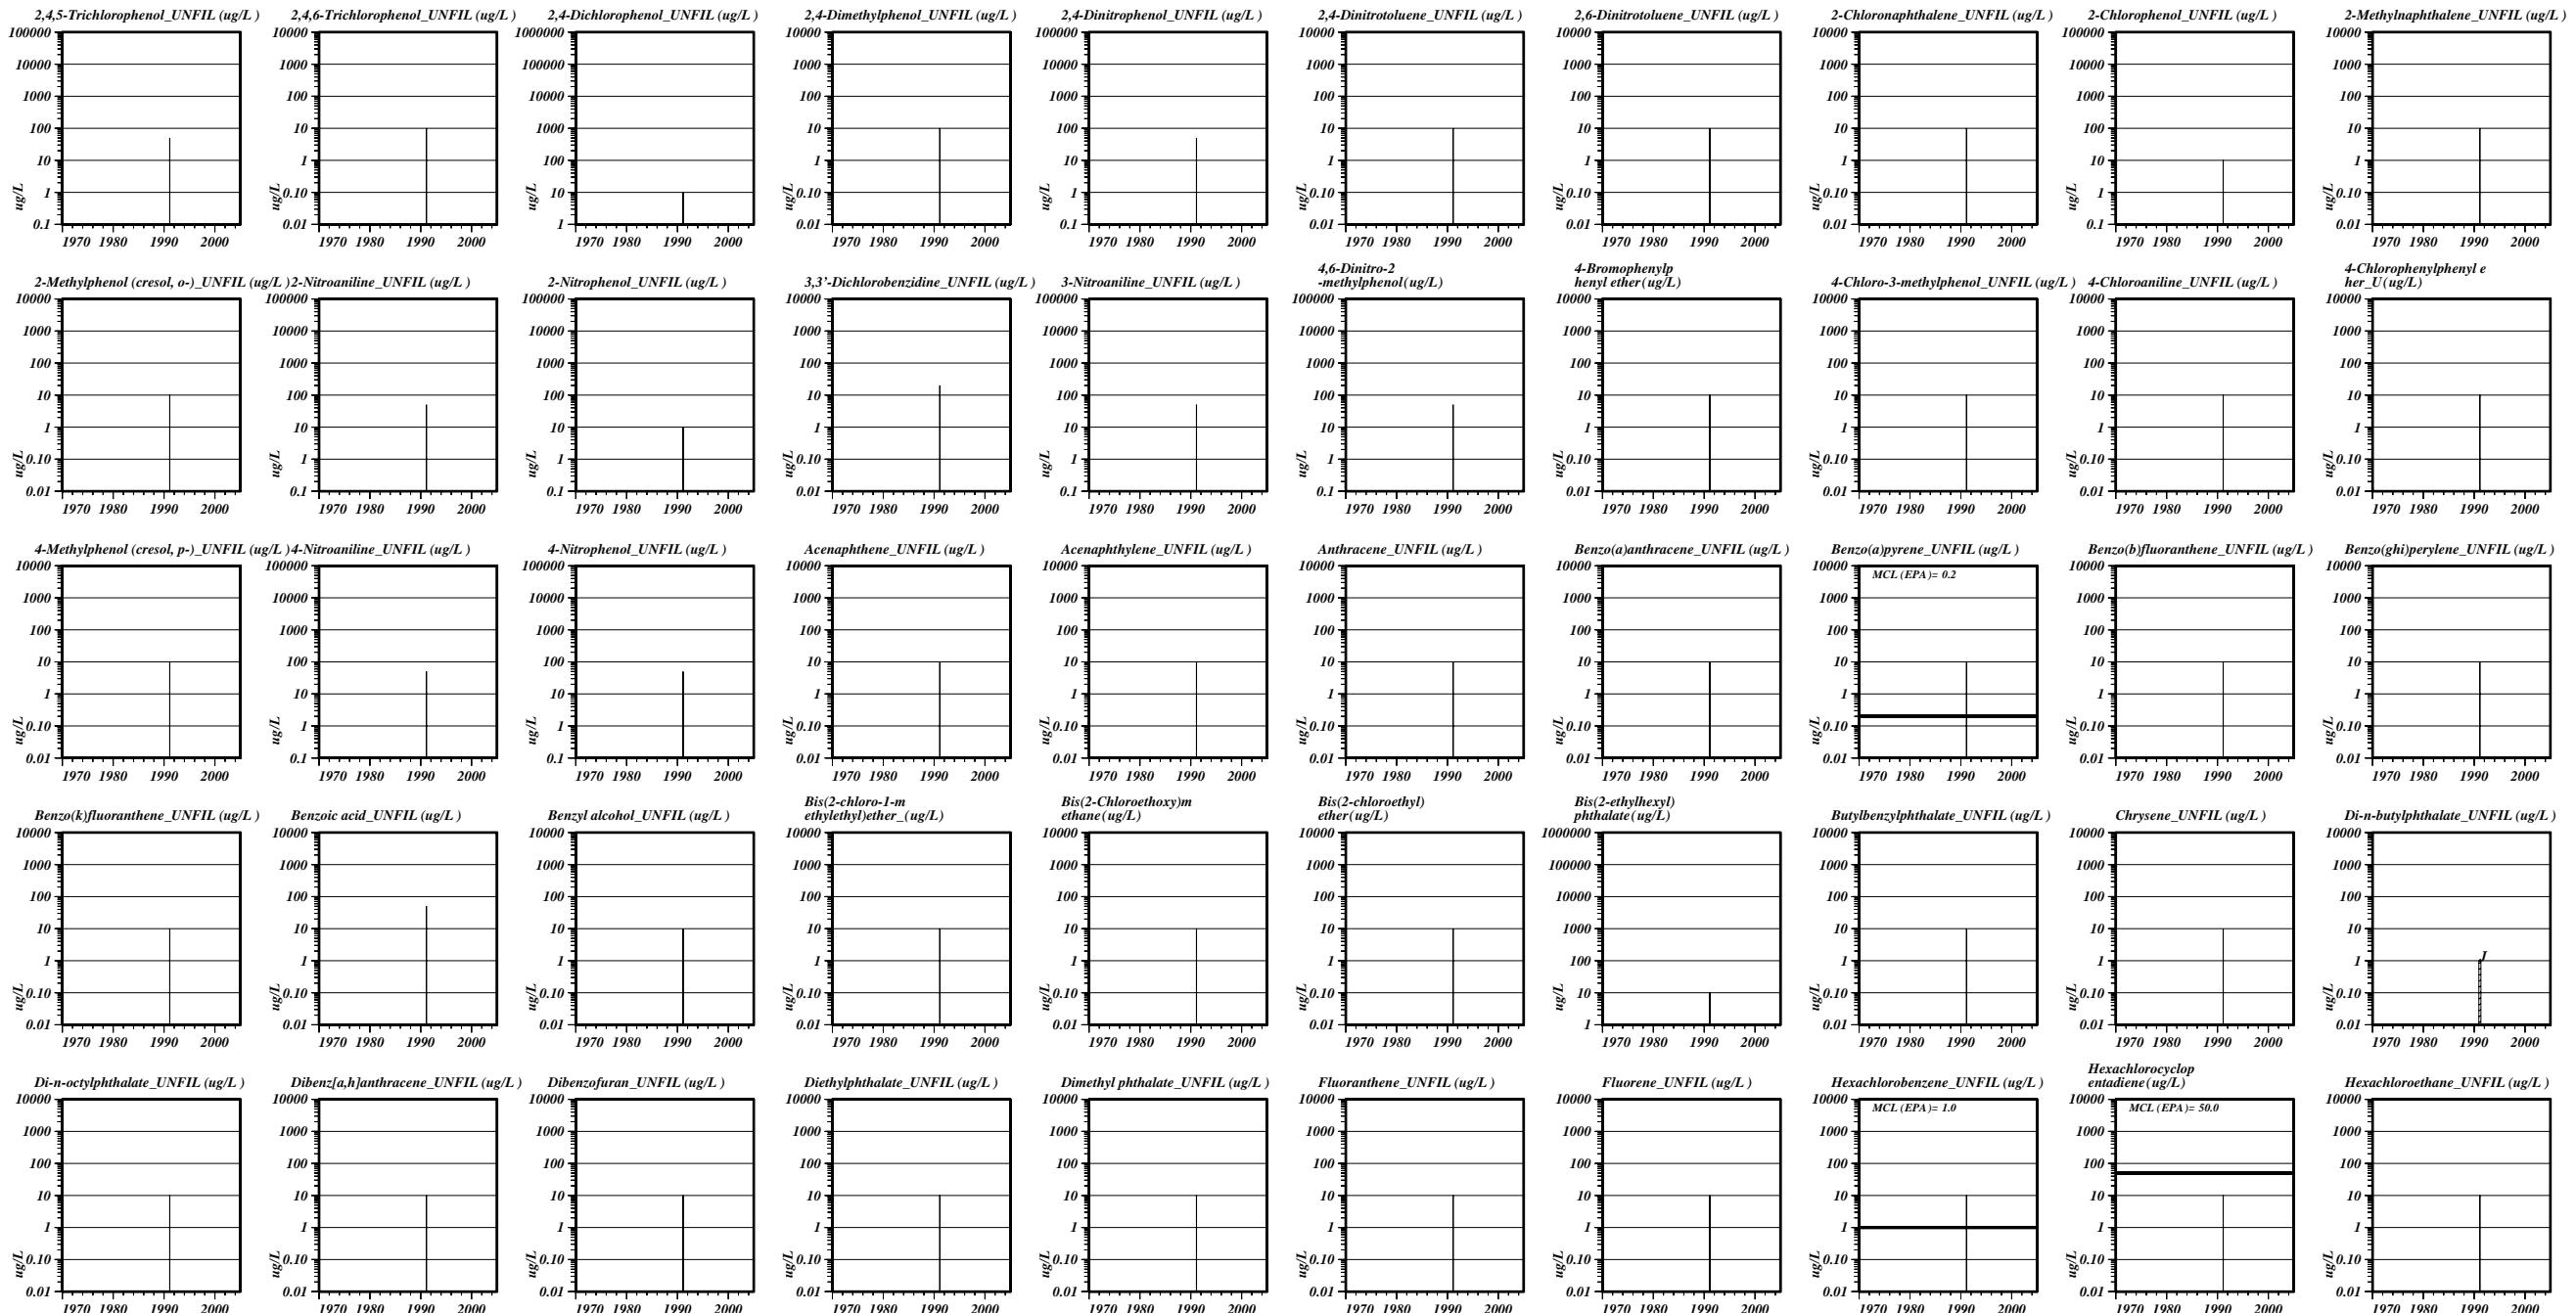

LABORATORY QUALIFIER FLAGS in HEIS are \*, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value:L=Value between IDL and CRQL (estimated):T=Tentatively identified compound:  
EPA-IGR=EPA-Implementation Guidance for Radionuclides: WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit:THIN BARS=Value Below Detection Limit:HATCHED BARS=Value With Data Qualifier Flag

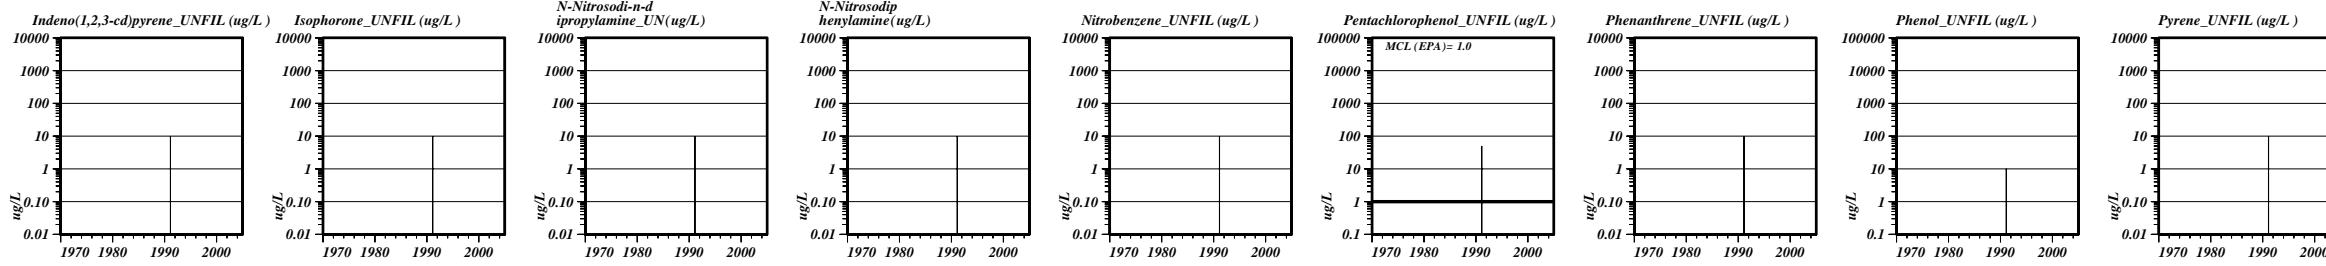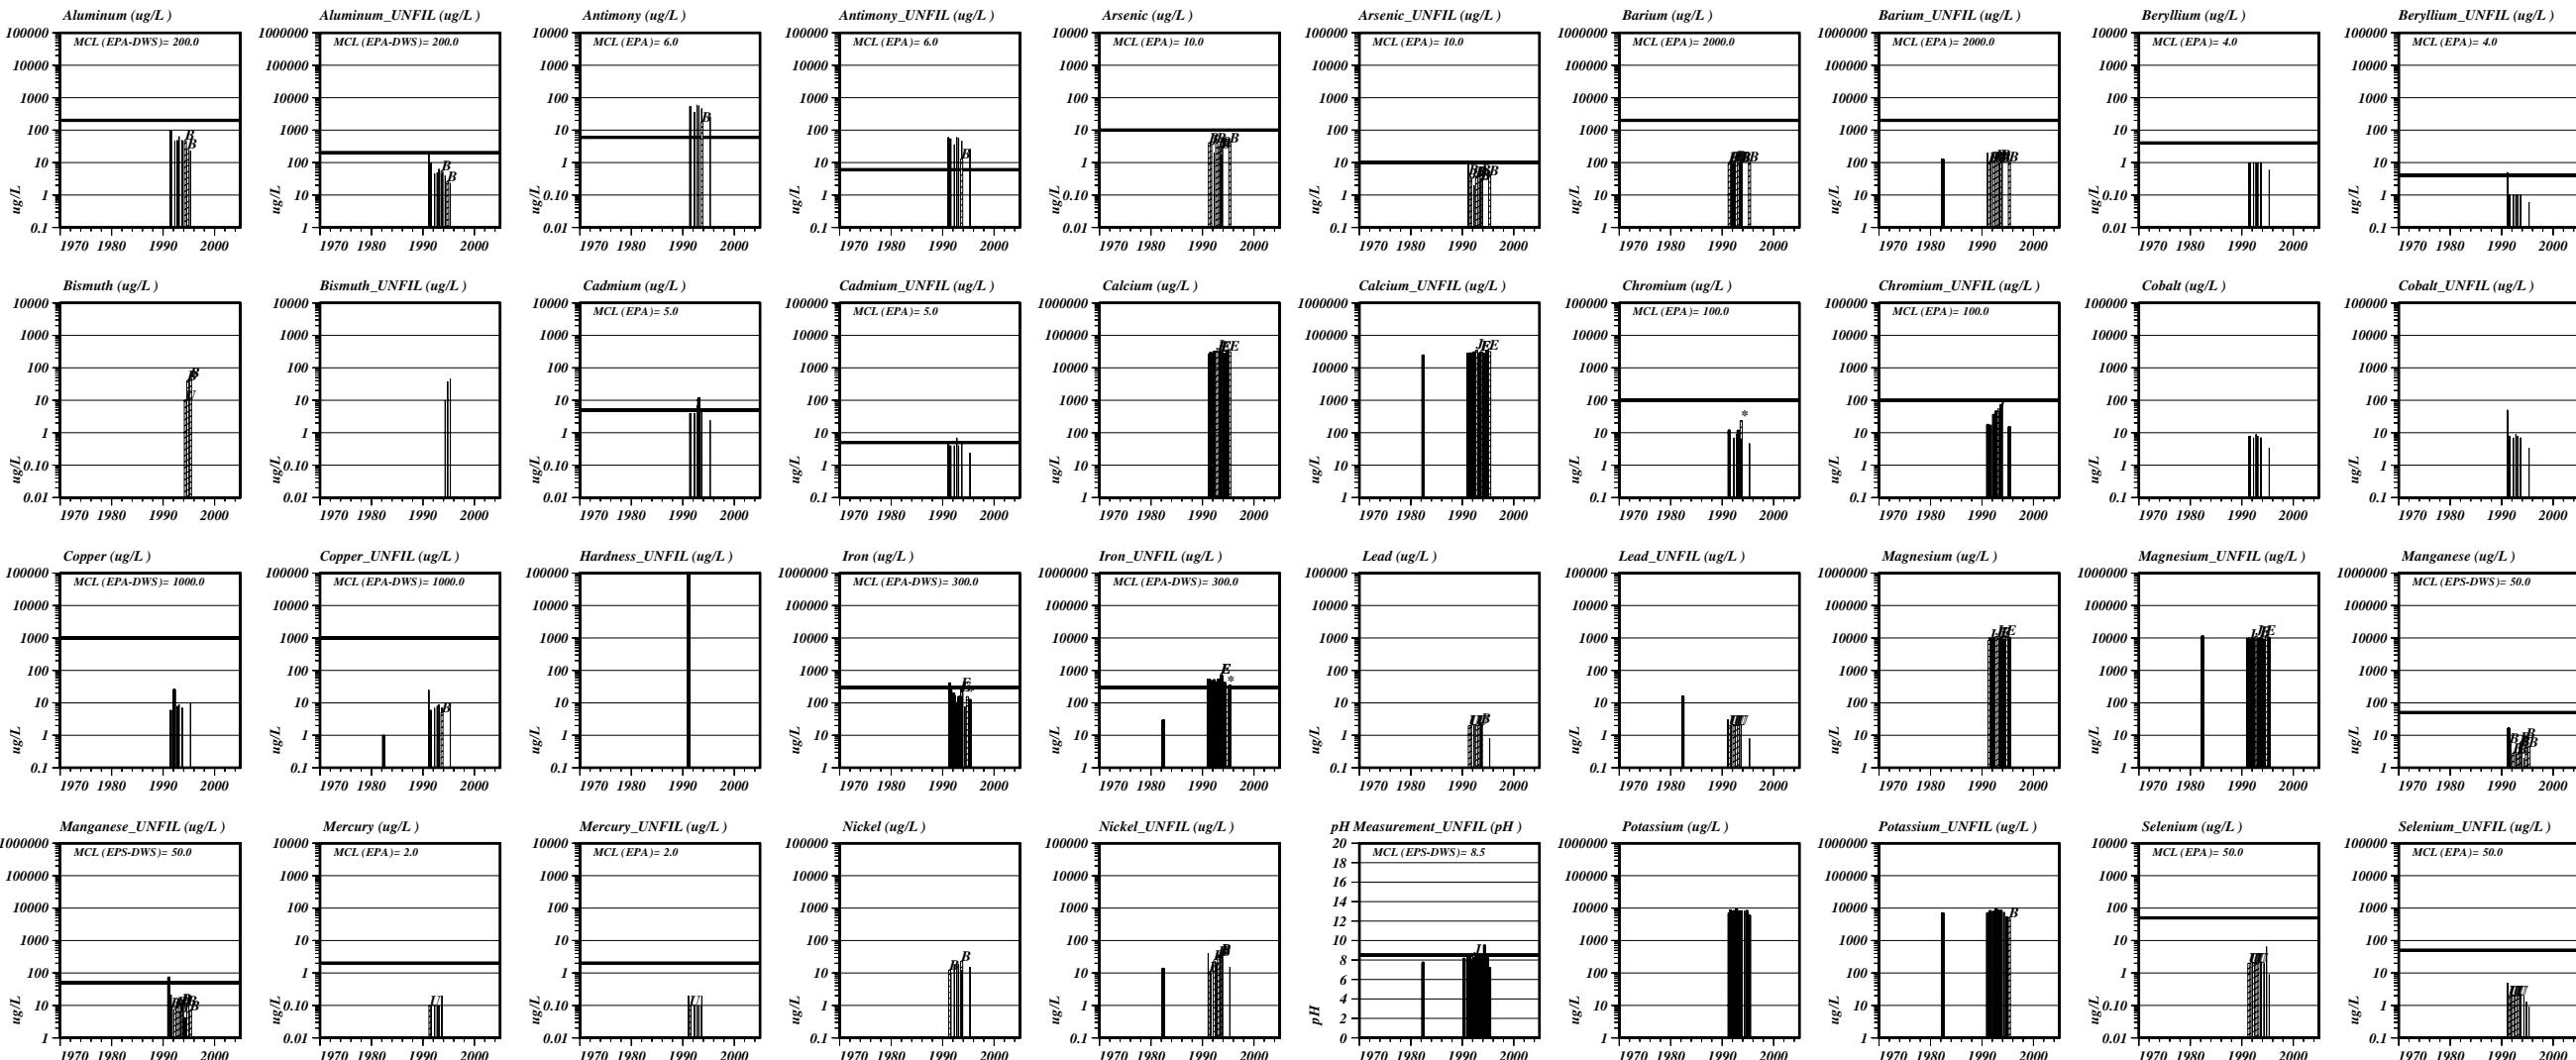
**SEMI-VOLATILE ORGANIC COMPOUNDS****METALS & PHYSICAL PARAMETERS**

LABORATORY QUALIFIER FLAGS in HEIS are \*; >; B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound;  
EPA-IGR=EPA-Implementation Guidance for Radionuclides; WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit; THIN BARS=Value Below Detection Limit; HATCHED BARS=Value With Data Qualifier Flag

DOE HANFORD SITE - GROUNDWATER QUALITY DATA PLOTS wellseries-600-699 WELL#=699-54-57

METALS & PHYSICAL PARAMETERS

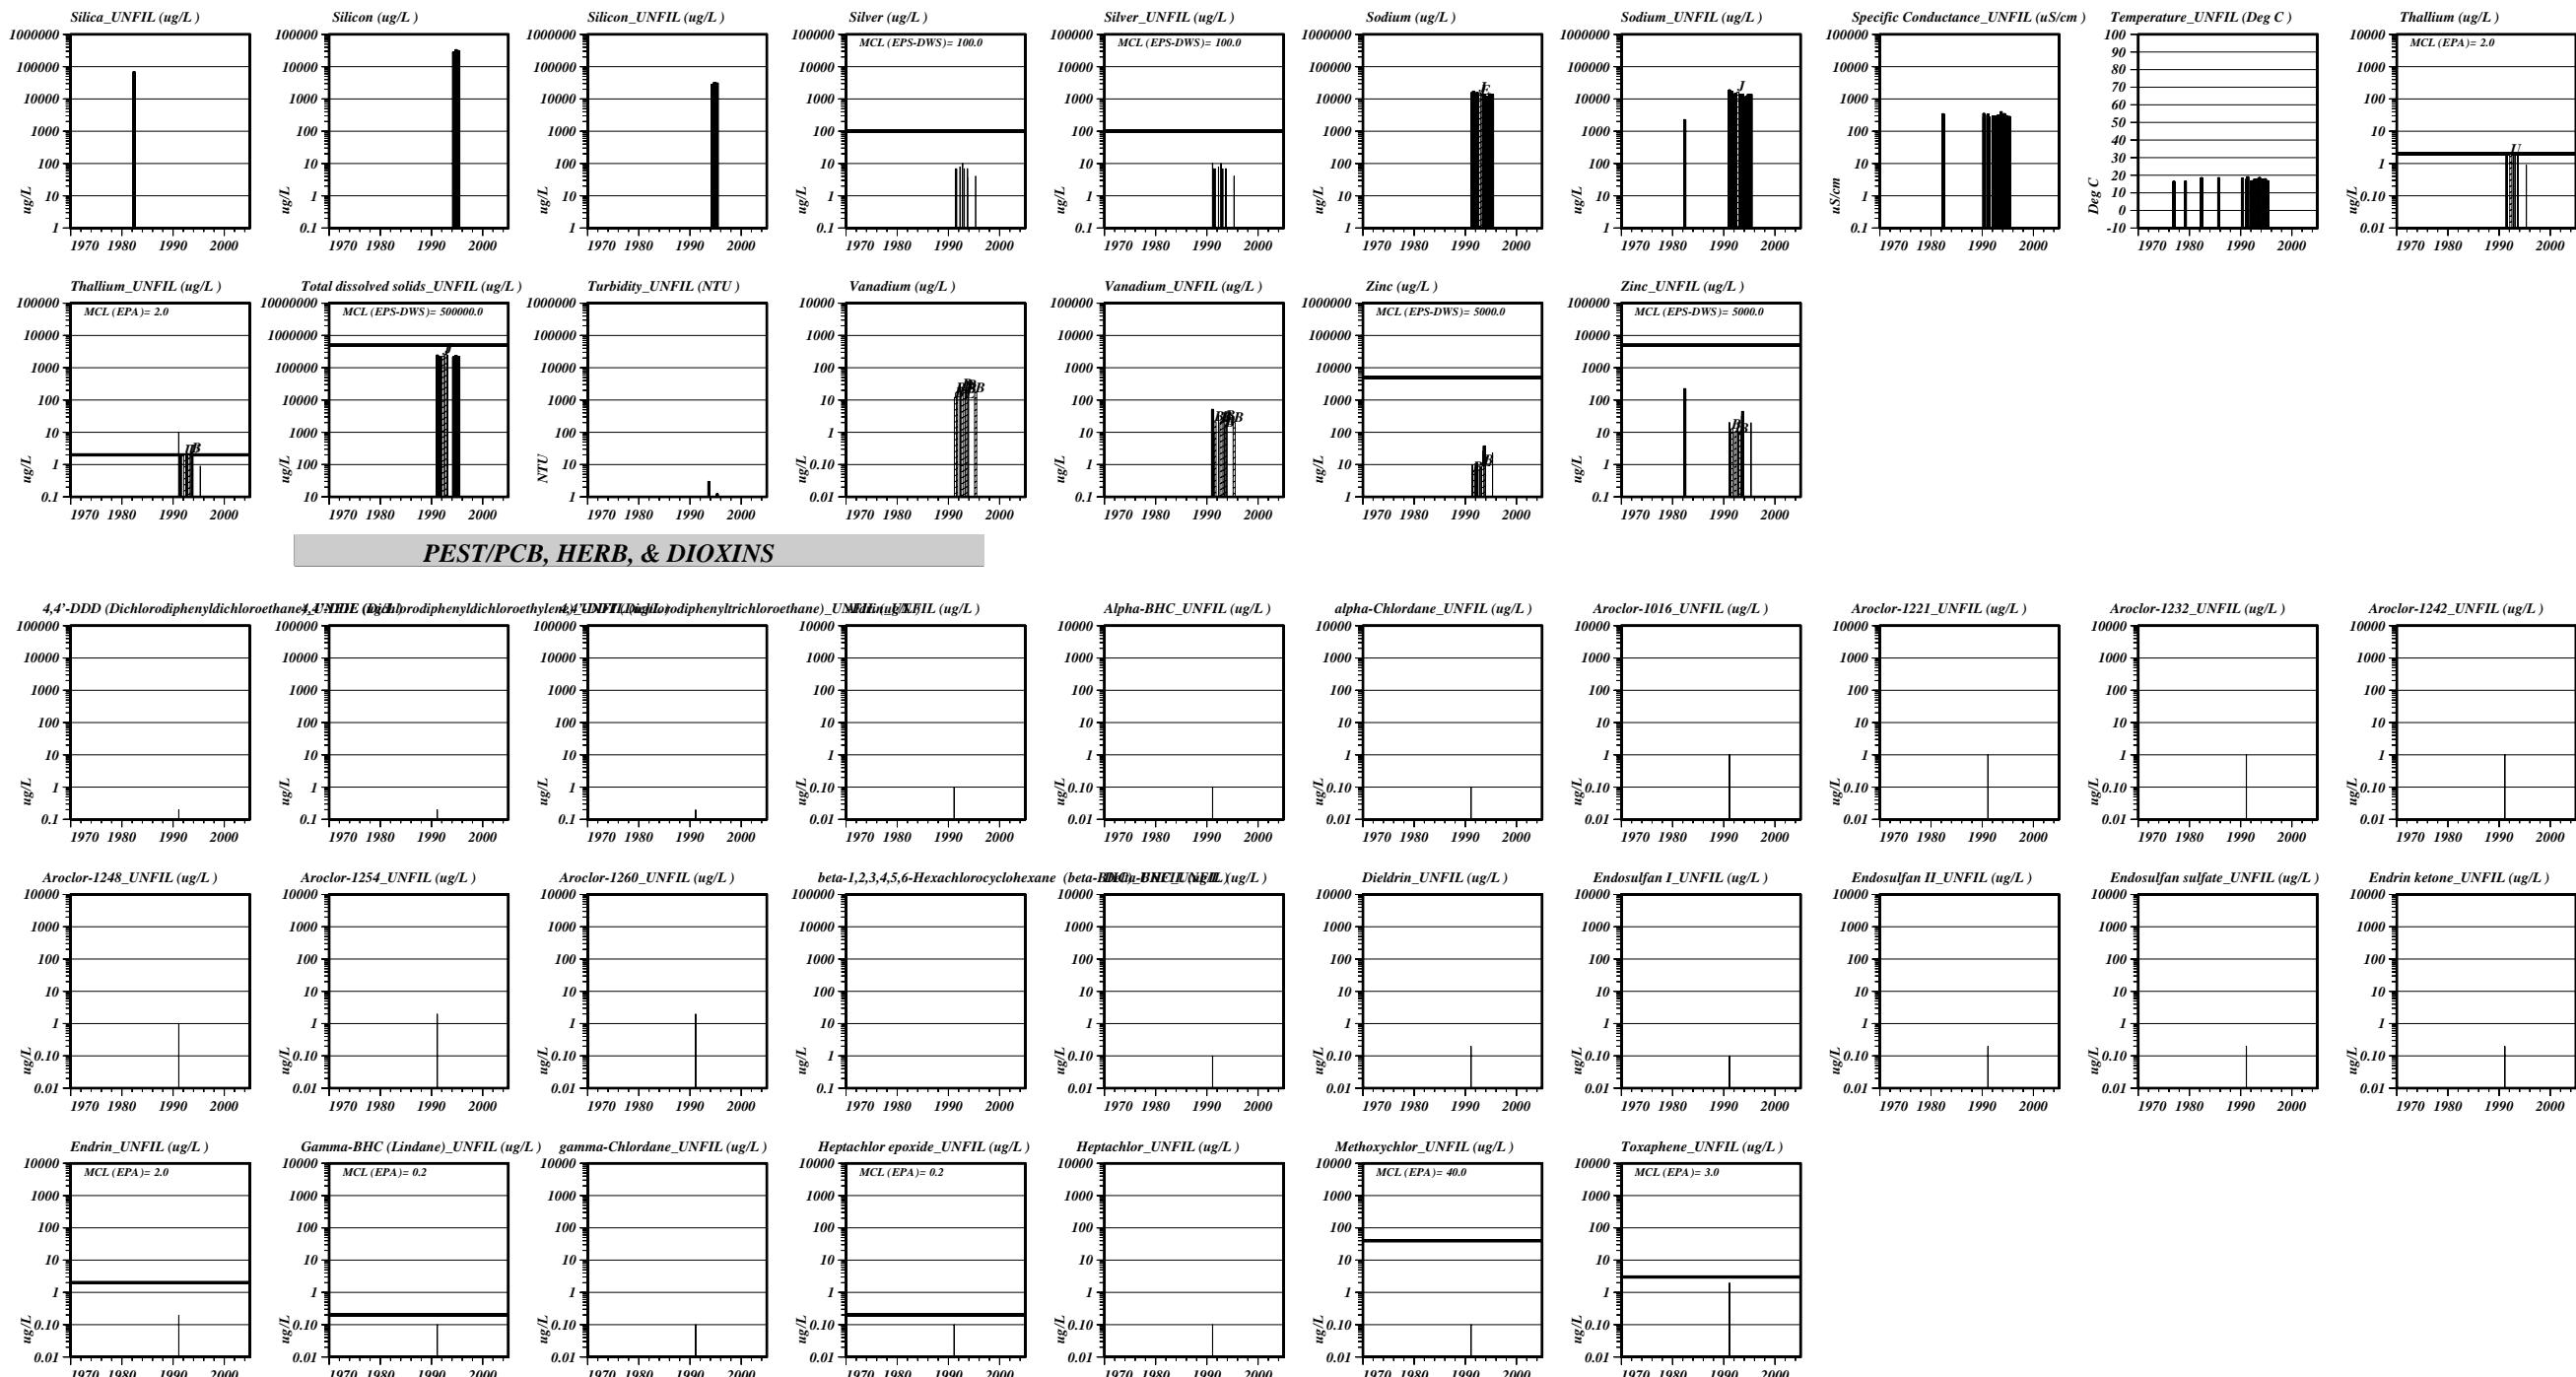

**LABORATORY QUALIFIER FLAGS in HEIS are \* , > , B , C , D , E , J , L , P , Q , R , W , X , Y , and Z: Review Document. Main Flags are : J=Estimated value; L=Value between IDL and CRQL (estimated); T=Tentatively identified compound**


**ETA-FGR-ETA Implementation Guidance for Radionuclides: WAC—Washington Administrative Code EXPLANATION: THICK-FILLED BARS** Value Above Protection Limit = **THIN BARS**

**EXPLANATION: THICK FILLED BARS=***Value Above Detection Limit***:THIN BARS=***Value Below Detection Limit***:HATCHED BARS=***Value With Data Qualifier Flag*

# DOE HANFORD SITE - GROUNDWATER QUALITY DATA PLOTS

wellseries-600-699 WELL#=699-54-57

## GENCHEM & ORGANICS & GENORGANICS

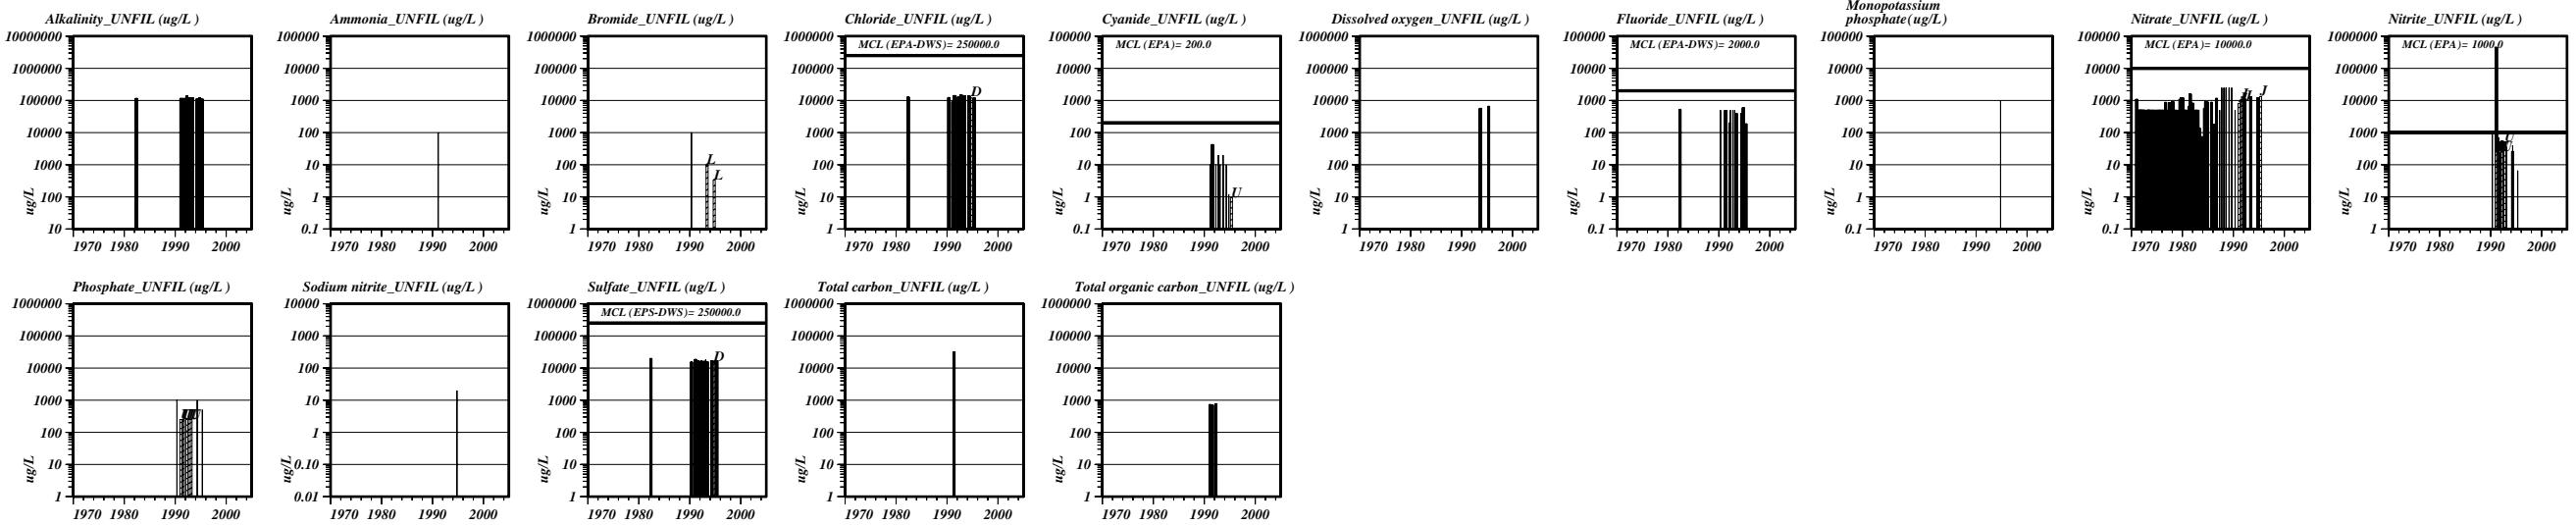

LABORATORY QUALIFIER FLAGS in HEIS are \*, >, B, C, D, E, J, L, P, Q, R, W, X, Y, and Z: Review Document. Main Flags are : J=Estimated value:L=Value between IDL and CRQL (estimated):T=Tentatively identified compound:  
EPA-IGR=EPA-Implementation Guidance for Radionuclides: WAC=Washington Administrative Code:

EXPLANATION: THICK FILLED BARS=Value Above Detection Limit:THIN BARS=Value Below Detection Limit:HATCHED BARS=Value With Data Qualifier Flag